

WARNING


This drawing is intended for quotation purposes ONLY

ALL cables may NOT be shown

MAINS RECORDS MUST BE OBTAINED BEFORE STARTING WORKS ON SITE

WARNING

GAS IN PLOT AREA
ENVIRONMENTAL ISSUES IN PLOT AREA
EHV CABLES & LINES IN PLOT AREA
ELECTRICITY GRID CIRCUIT (3rd Party) WITHIN 50M VICINITY
MAJOR PIPELINE WITHIN 50M VICINITY CONTACT WWW.LINESEARCH.ORG OR PIPELINE OPERATOR. (OTHERS MAY EXIST)

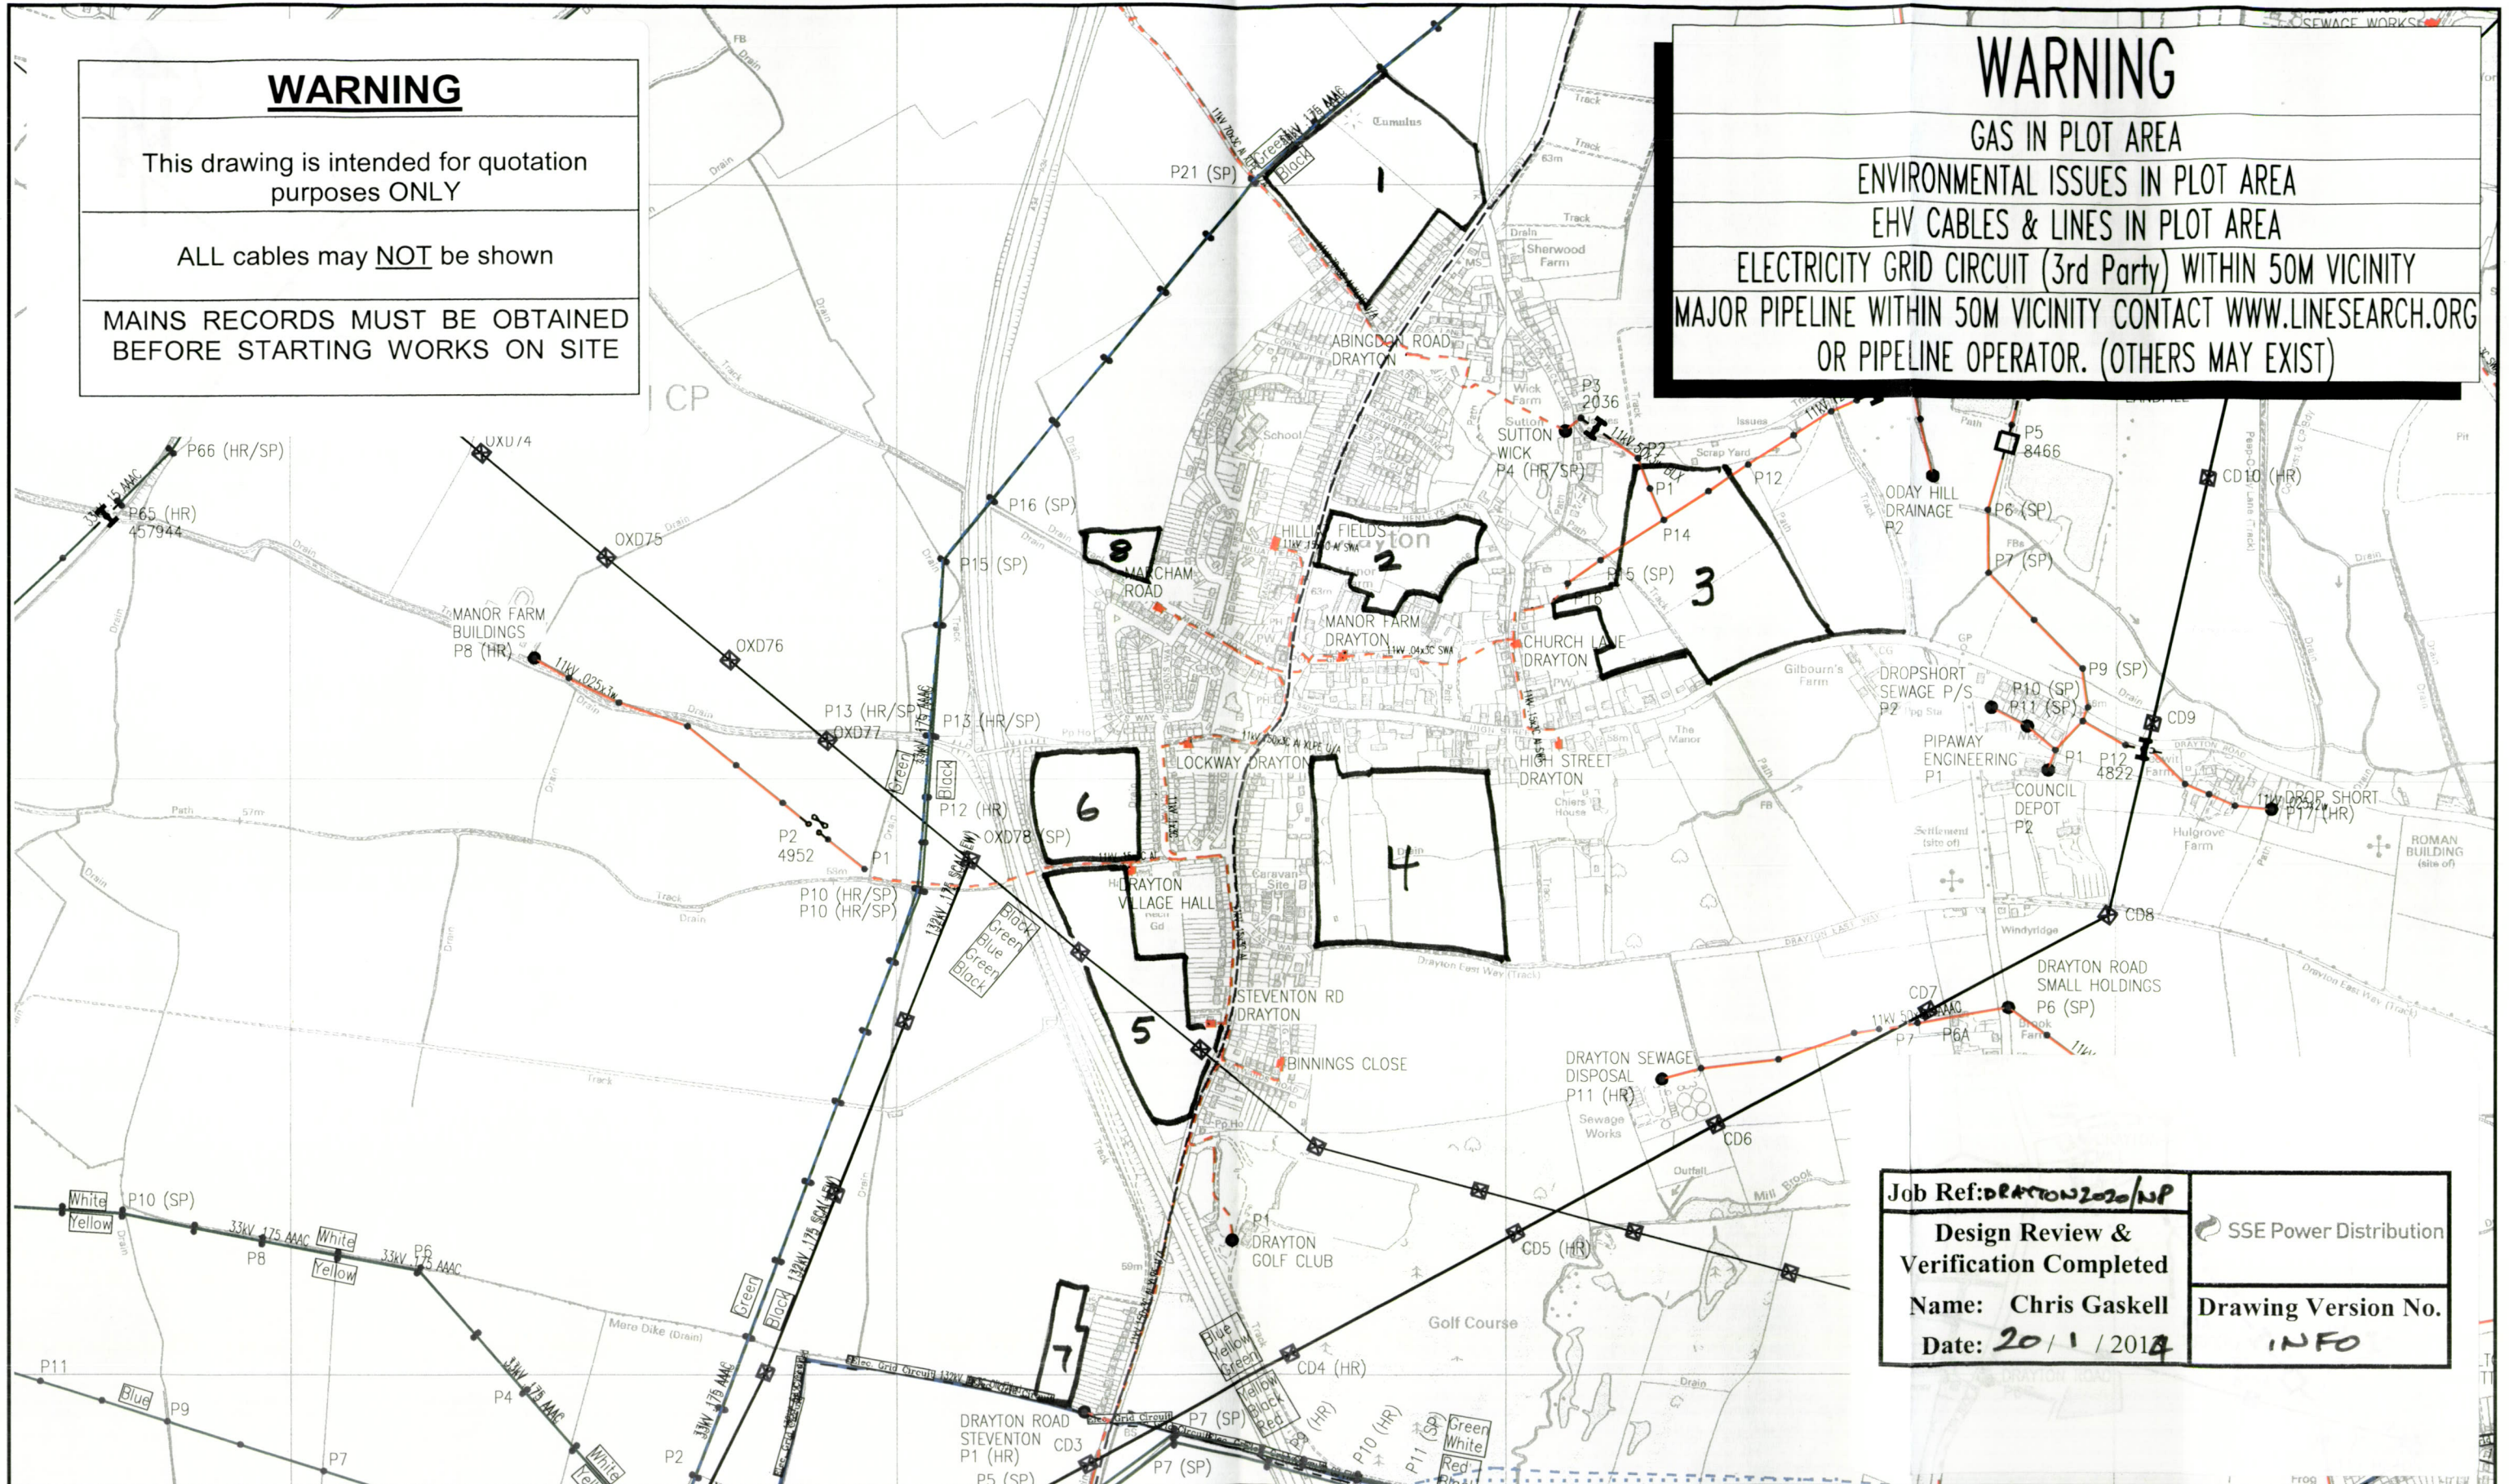

Job Ref: DRAYTON 2014/NP
Design Review & Verification Completed
Name: Chris Gaskell
Date: 20/1/2014
SSE Power Distribution
Drawing Version No. INFO

	services l.v.	h.v.	e.h.v.	
FOOTPATH	0.40m	0.45m	0.60m	0.75m
ROAD CROSSING	0.60m	0.60m	0.75m	0.90m
l.v./services	- up to 1000V.			
h.v.	- over 1000V. to 11,000V.			
e.h.v.	- 22,000V. to 132,000V.			

WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depth of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. (available from HMSO)

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE GS9 SHOULD BE CONSULTED. (AVAILABLE FROM HMSO)


BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of SOUTHERN ELECTRIC plc pursuant to section 47 of the Copyright, Designs and Patents Act 1988 (the Act), inasmuch as the Act provides a limited exception to copyright, the copy must not be copied without the prior permission of the copyright owner.

Template: SIAS NS29A COL A3 A3

Scottish and Southern Energy plc.
Registered in Scotland No 117119.
Registered Office: Inverlind House
20 Dunkeld Road,
Perth, PH1 3AQ.

UNCONTROLLED COPY
Subject to Revision Master held at



H.V. MAINS RECORD
OXFORD
01865-845800

Grid Ref: SU47589405
Scale: 1:10000
Date: 10/01/2014